


Lead Sulfide Infrared (PbS) Detector Array

(0.5 - 3 microns)



DATASHEET

BUY NOW

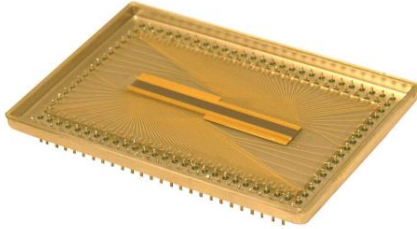


Features

- New Automated Chemical Processing (ACP) produces higher yield at lower cost.
- Extremely high reliability under extreme conditions.
- Long shelf life.
- Hermetically sealed package to completely eliminate humidity attack on detection area.
- Wide range of electrical characteristics available.
- Wide range of sizes available.
- 100% tested.
- State of the art microelectronics fabrication capability.
- Specializing in high density arrays. 64/128 element, etc.


Applications

Agiltron manufactures state-of-the-art lead sensitivity Sulfide (PbS) for room temperature operation as well as thermoelectrically cooled operation for spectroscopy from 0.5 to 3 microns. We offer customer linear array design and package to meet the application requirements. The device can be supplied with integrated optical filters. It can be connected with pre-amplifiers or multiplexed amplifiers for applications. Thermoelectronic cooler and thermistor can be built in for temperature stabilization.

Listed below is typical 128 element electrical characteristics of PbS Array of Agiltron Automated Chemical Processing (ACP) detectors.

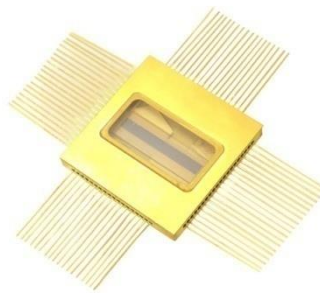

64 Array

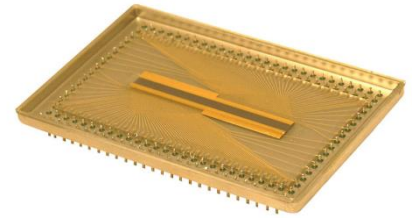

128 Array

Specifications

Parameter	Min	Typical	Max	Unit
Operating Wavelength Range (PbS)	1		3	μm
Number of Elements		64		
Resistance	0.3		0.5	M Ω
Response Time	300		400	μs
Peak Detectivity (without cooling)	$D^*: 1 \times 10^{11} \text{ (cm} \cdot \text{Hz}^{1/2} \cdot \text{W}^{-1}\text{)}$			

Rev 05/22/23

© Photonwares Corporation

P +1 781-935-1200

E sales@photonwares.com

W www.agiltron.com

Lead Sulfide Infrared (PbS) Detector Array

(0.5 - 3 microns)



DATASHEET

Mechanical Features


PbS Detector array is typically manufactured on quartz substrate. Devices can be supplied integrated with optical condenser elements, thermoelectric (TE) coolers, and processing electronics, all in a miniature package.

Aging Characteristics

All stock detector arrays undergo a minimum four week aging period. Experience with detectors manufactured by the advanced process, including the above aging period, has shown the electrical characteristics to be stable to within 10% for over a year.

Response of Detectors

The typical response for PbS operates in 0.5 to 3 micron spectral region with time constants below 400 μ sec. TE-cooled packages are available with a response in the 0.5 to 3 micron region with increased D^* . Typical spectral response of standard PbS detector is shown below.

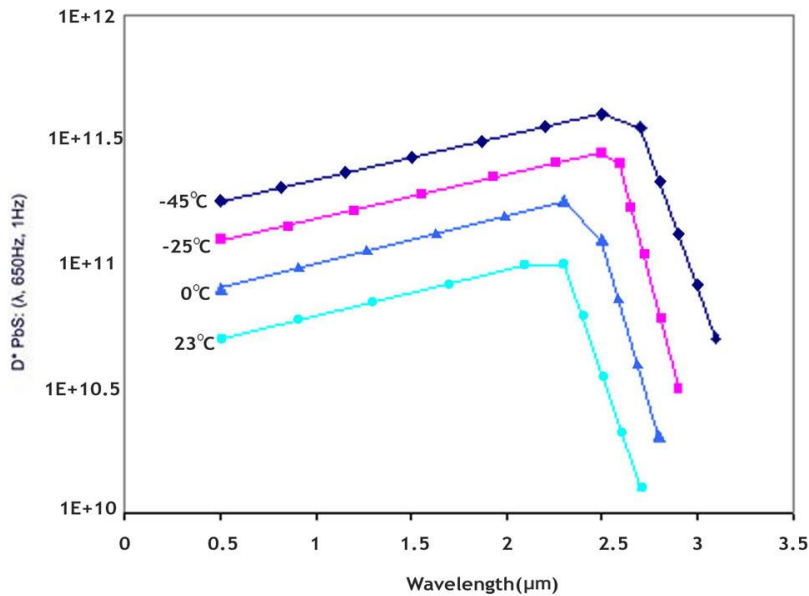

Ordering Information

Prefix	Elements	Pixel Width	Pixel Length	Pixel pitch	TEC	Package
PBSA-	4 = 004 6 = 006 10 = 010 ... 128 = 128	15 μ m = 015 115 μ m = 115 260 μ m = 260	15 μ m = 015 115 μ m = 115 260 μ m = 260	15 μ m = 015 115 μ m = 115 260 μ m = 260	No = 1 Yes = 2	Toxx = 1 Square A = 2 Square B = 3

*Product dimensions may change without notice. This is sometimes required for non-standard specifications.